




HIRSCHMANN

A **BELDEN** BRAND

User Manual

Installation Building Automation Switch BAS

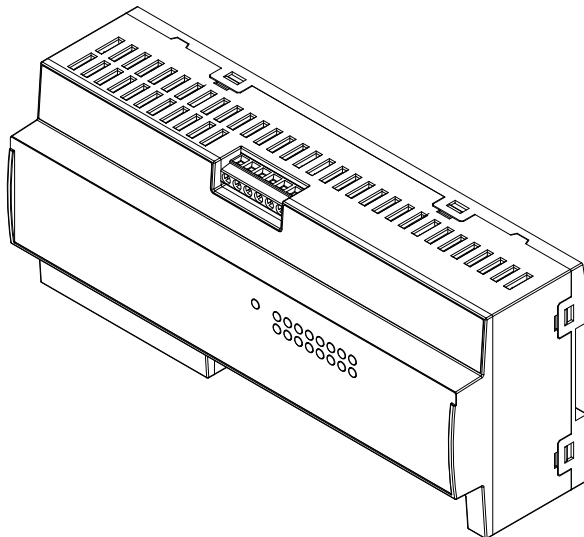

The naming of copyrighted trademarks in this manual, even when not specially indicated, should not be taken to mean that these names may be considered as free in the sense of the trademark and tradename protection law and hence that they may be freely used by anyone.

© 2021 Hirschmann Automation and Control GmbH

Manuals and software are protected by copyright. All rights reserved. The copying, reproduction, translation, conversion into any electronic medium or machine scannable form is not permitted, either in whole or in part. An exception is the preparation of a backup copy of the software for your own use.

The performance features described here are binding only if they have been expressly agreed when the contract was made. This document was produced by Hirschmann Automation and Control GmbH according to the best of the company's knowledge. Hirschmann reserves the right to change the contents of this document without prior notice. Hirschmann can give no guarantee in respect of the correctness or accuracy of the information in this document.

Hirschmann can accept no responsibility for damages, resulting from the use of the network components or the associated operating software. In addition, we refer to the conditions of use specified in the license contract.

You can get the latest version of this manual on the Internet at the Hirschmann product site (www.hirschmann.com).

Hirschmann Automation and Control GmbH
Stuttgarter Str. 45-51
72654 Neckartenzlingen
Germany

Contents

Important information	5
Safety instructions	7
About this Manual	13
Key	14
1 Description	15
1.1 General device description	15
1.2 Device view	15
1.2.1 Front view	15
1.2.2 View from below	16
1.3 Power supply	17
1.3.1 Supply voltage LV	17
1.3.2 Supply voltage HV	17
1.4 Ethernet ports	17
1.4.1 10/100/1000 Mbit/s twisted pair port	18
1.4.2 10/100 Mbit/s twisted pair port	18
1.4.3 Support of PoE	18
1.4.4 10/100/1000 Mbit/s PoE port	20
1.4.5 10/100 Mbit/s PoE port	20
1.5 Pin assignments	21
1.6 Display elements	22
1.6.1 Device state	22
1.6.2 Port status	22
2 Installation	23
2.1 Checking the package contents	23
2.2 Installing and grounding the device	23
2.2.1 Installing the device onto the DIN rail	23
2.2.2 Grounding the device	24
2.3 Connecting the terminal blocks	24
2.3.1 Supply voltage LV	25
2.3.2 Supply voltage HV	26

2.4	Connecting data cables	26
2.5	Attach touch protection	27
2.6	Operating the device	27
3	Monitoring the ambient air temperature	28
4	Maintenance and service	29
5	Disassembly	30
5.1	Removing the device	30
6	Technical data	31
A	Further support	38

Important information

Note: Read these instructions carefully, and familiarize yourself with the device before trying to install, operate, or maintain it. The following notes may appear throughout this documentation or on the device. These notes warn of potential hazards or call attention to information that clarifies or simplifies a procedure.

■ Symbol explanation



This is a general warning symbol. This symbol alerts you to potential personal injury hazards. Observe all safety notes that follow this symbol to avoid possible injury or death.



If this symbol is displayed in addition to a safety instruction of the type “Danger” or “Warning”, it means that there is a danger of electric shock and failure to observe the instructions will inevitably result in injury.



This symbol indicates the danger of hot surfaces on the device. In connection with safety instructions, non-observance of the instructions will inevitably result in injuries.



DANGER

DANGER draws attention to an immediately dangerous situation, which will **inevitably** result in a serious or fatal accident if not observed.



WARNING

WARNING indicates a potentially hazardous situation which, if not avoided, **could** result in death or serious injury.



CAUTION

CAUTION indicates a possible danger which, if not avoided, **may** result in minor injuries.

NOTICE

NOTE provides information about procedures that do not involve the risk of injury.

Safety instructions

■ General safety instructions

You operate this device with electricity. Improper usage of the device entails the risk of physical injury or significant property damage. The proper and safe operation of this device depends on proper handling during transportation, proper storage and installation, and careful operation and maintenance.

- Before connecting any cable, read this document, and the safety instructions and warnings.
- Operate the device with undamaged components exclusively.
- The device is free of any service components. In case of a damaged or malfunctioning device, turn off the supply voltage and return the device to Hirschmann for inspection.
- Disconnect the device from the power supply before mounting.

■ Certified usage

- Use the product only for the application cases described in the Hirschmann product information, including this manual.
- Operate the device only in a closed casing (distribution board).
- Operate the product only according to the technical specifications.
[See "Technical data" on page 31.](#)
- Ensure that the minimum distance of 10 mm (0.39 in) between datalines/telecommunication lines and power lines is maintained.
- Connect to the product only components suitable for the requirements of the specific application case.

■ Strain relief

Note: If the strain relief is insufficient, there is a potential risk of torsion, contact problems and creeping interruptions.

- Relieve the connection points of cables and lines from mechanical stress.
- Design strain reliefs in such a way that they help prevent any mechanical damage to cables, wires or conductors caused by external influences or their own weight.
- To help prevent damage to device connections, connectors and cables, follow the instructions for proper installation in accordance with DIN VDE 0100-520:2013-06, sections 522.6, 522.7 and 522.13.

■ **Device casing**

Only technicians authorized by the manufacturer are permitted to open the casing.

- Never insert pointed objects (narrow screwdrivers, wires, etc.) into the device or into the connection terminals for electric conductors. Do not touch the connection terminals.
- Keep the ventilation slits free to ensure good air circulation.
[See “General technical data” on page 31.](#)
- Mount the device in the vertical position.

■ **Qualification requirements for personnel**

- Only allow qualified personnel to work on the device.

Qualified personnel have the following characteristics:

- ▶ Qualified personnel are properly trained. Training as well as practical knowledge and experience make up their qualifications. This is the prerequisite for grounding and labeling circuits, devices, and systems in accordance with current standards in safety technology.
- ▶ Qualified personnel are aware of the dangers that exist in their work.
- ▶ Qualified personnel are familiar with appropriate measures against these hazards in order to reduce the risk for themselves and others.
- ▶ Qualified personnel receive training on a regular basis.

■ **National and international safety regulations**

Verify that the electrical installation meets local or nationally applicable safety regulations.

■ **Grounding the device**

The device is grounded via a 6-pin terminal block.

- Use a wire diameter for the ground conductor that is no smaller than the diameter of the supply voltage connection, however of at least 0.5 mm² (AWG20).

■ **Shielding ground**

The shielding ground of the connectable twisted pair cables is connected to the ground connection as a conductor.

- Beware of possible short circuits when connecting a cable section with conductive shielding braiding.

■ Requirements for connecting electrical wires

Before connecting the electrical wires, **always** verify that the requirements listed are complied with.

General requirements for connecting electrical wires

The following requirements apply without restrictions:

- ▶ The electrical wires are voltage-free.
- ▶ The cables used are permitted for the temperature range of the application case.
- ▶ Relevant for North America:
Exclusively use 60/75 °C (140/167 °F) or 75 °C (167 °F) copper (Cu) wire.
- ▶ Enable the supply voltage for the device only when the following requirements are fulfilled:
 - the terminal blocks are wired correctly
 - the device casing is closed

Requirements for connecting the supply voltage

Supply voltage LV

Device variant

BAS20-8TX

The following requirements apply without restrictions:

- ▶ The supply voltage corresponds to the voltage specified on the type plate of the device.
- ▶ The power supply conforms to overvoltage category I or II.
- ▶ The power supply has an easily accessible disconnecting device (for example a switch or a plug). This disconnecting device is clearly identified. So in the case of an emergency, it is clear which disconnecting device belongs to which power supply cable.
- ▶ The power supply cable is suitable for the voltage, the current and the physical load. Hirschmann recommends a wire diameter of 0.5 mm² (AWG20).
- ▶ The cross-section of the ground conductor is the same size as or bigger than the cross-section of the power supply cables.

The following requirements apply alternatively:

- | | |
|---------------|---|
| Alternative 1 | The power supply complies with the requirements for a limited power source (LPS). |
| Alternative 2 | <p>All of the following requirements are complied with:</p> <ul style="list-style-type: none">▶ The power supply complies with the requirements for a safety extra-low voltage (SELV). <p>Supply with DC voltage:</p> <ul style="list-style-type: none">▶ A back-up fuse suitable for DC voltage is located in the plus conductor of the power supply.
The minus conductor is on ground potential. Otherwise, a back-up fuse is also located in the minus conductor.
Regarding the properties of this back-up fuse:
See “General technical data” on page 31. <p>Supply with AC voltage:</p> <ul style="list-style-type: none">▶ A back-up fuse is located in the outer conductor of the power supply.
The neutral conductor is on ground potential at both voltage inputs.
Otherwise, a back-up fuse is also located in the neutral conductor.
Regarding the properties of this back-up fuse:
See “General technical data” on page 31. |

Requirements for connecting the supply voltage

Supply voltage HV

Device variants

BAS20-8TX-HV, BAS22-8TX-HV...

The following requirements apply without restrictions:

- ▶ The supply voltage corresponds to the voltage specified on the type plate of the device.
- ▶ The power supply complies with overvoltage category I or II or III.
- ▶ The power supply has an easily accessible disconnecting device (for example a switch or a plug). This disconnecting device is clearly identified. So in the case of an emergency, it is clear which disconnecting device belongs to which power supply cable.
- ▶ The power supply cable is suitable for the voltage, the current and the physical load. Hirschmann recommends a wire diameter of 0.5 mm² (AWG20).
- ▶ A back-up fuse is located in the outer conductor of the power supply. The neutral conductor is on ground potential at both voltage inputs. Otherwise, a back-up fuse is also located in the neutral conductor. Regarding the properties of this back-up fuse:
[See "General technical data" on page 31.](#)
- ▶ The cross-section of the ground conductor is the same size as or bigger than the cross-section of the power supply cables.

■ **Supply voltage**

The supply voltage is only connected with the ground connection via protective elements.

■ **CE marking**

The labeled devices comply with the regulations contained in the following European directive(s):

2011/65/EU and 2015/863/EU (RoHS)

Directive of the European Parliament and of the Council on the restriction of the use of certain hazardous substances in electrical and electronic equipment.

2014/30/EU (EMC)

Directive of the European Parliament and of the Council on the harmonisation of the laws of the Member States relating to electromagnetic compatibility.

In accordance with the above-named EU directive(s), the EU conformity declaration will be available to the relevant authorities at the following address:

Hirschmann Automation and Control GmbH
Stuttgarter Str. 45-51
72654 Neckartenzlingen
Germany

You find the EU conformity declaration as PDF file for downloading on the Internet at: <https://www.doc.hirschmann.com/certificates.html>

The product can be used in the industrial sector.

- ▶ Interference immunity: EN 61000-6-2
- ▶ Emitted interference: EN 55032
- ▶ Safety: EN IEC 61010-2-201

You find more information on technical standards here:

[“Technical data” on page 31](#)

Note: The assembly guidelines provided in these instructions must be strictly adhered to in order to observe the EMC threshold values.

■ **FCC note**

Supplier's Declaration of Conformity 47 CFR § 2.1077 Compliance Information

Building Automation Switch
BAS

U.S. Contact Information

Belden – St. Louis
1 N. Brentwood Blvd. 15th Floor
St. Louis, Missouri 63105, United States
Phone: 314.854.8000

This device complies with part 15 of the FCC Rules. Operation is subject to the following two conditions: (1) This device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation.

Note: This equipment has been tested and found to comply with the limits for a Class A digital device, pursuant to part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference when the equipment is operated in a commercial environment. This equipment generates, uses, and can radiate radio frequency energy and, if not installed and used in accordance with the instruction manual, may cause harmful interference to radio communications. Operation of this equipment in a residential area is likely to cause harmful interference in which case the user will be required to correct the interference at his own expense.

■ **Recycling note**

After usage, this device must be disposed of properly as electronic waste, in accordance with the current disposal regulations of your county, state, and country.

About this Manual

The “Installation” user manual contains a device description, safety instructions, a description of the display, and the other information that you need to install the device.

Documentation mentioned in the “User Manual Installation” that is not supplied with your device as a printout can be found as PDF files for downloading on the Internet at: <https://www.doc.hirschmann.com>

Key

The symbols used in this manual have the following meanings:

▶	Listing
□	Work step
■	Subheading

1 Description

1.1 General device description

The device is designed for the special requirements of building automation. The device is designed for installation in electrical distribution boards and small casings for rapid mounting on a 35 mm (1.38 in) mounting rail in accordance with EN 60715. The device meets the relevant industry standards, provides very high operational reliability, even under extreme conditions, and also long-term reliability and flexibility.

1.2 Device view

1.2.1 Front view

■ Example of a device variant without PoE

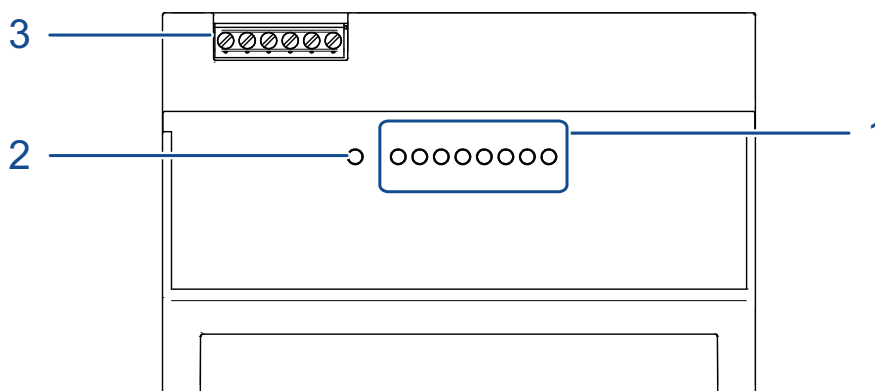


Figure 1: Example of a device variant without PoE

1	LED display elements for port status
2	LED display element for device status
3	6-pin terminal block with screw lock

■ Example of a device variant with PoE

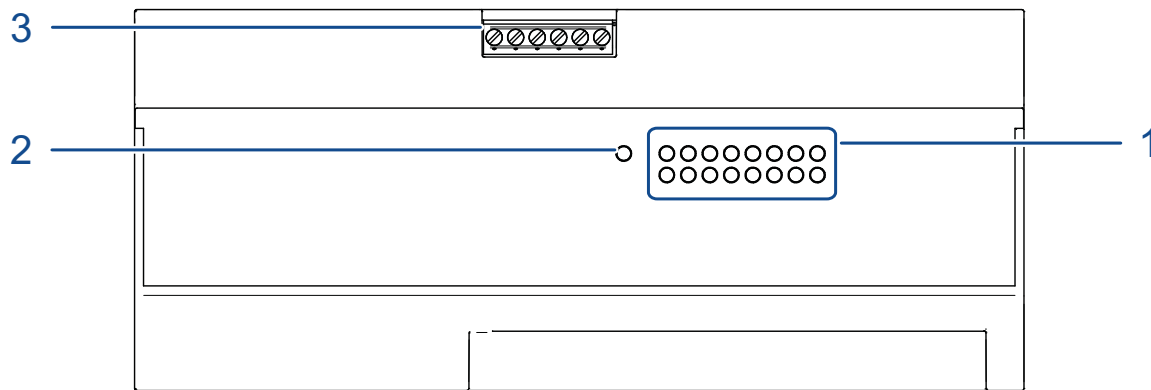


Figure 2: Example of a device variant with PoE

1	LED display elements for port status
2	LED display element for device status
3	6-pin terminal block with screw lock

1.2.2 View from below

■ Example of a device variant without PoE

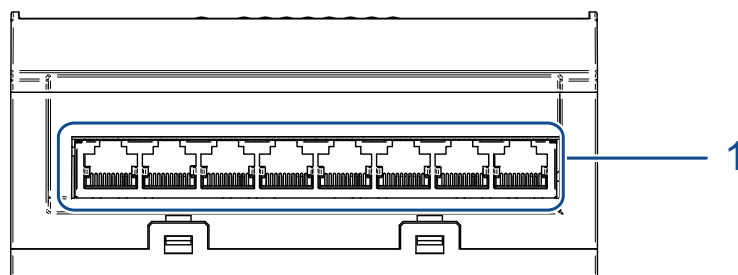


Figure 3: Example of a device variant without PoE

1	8 × RJ45 socket for 10/100/1000 Mbit/s Twisted Pair connections
---	---

■ Example of a device variant with PoE

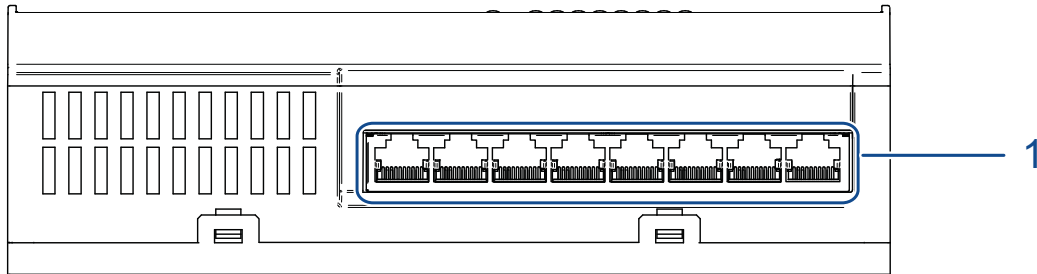


Figure 4: Example of a device variant with PoE

1 8 × RJ45 socket for 10/100/1000 Mbit/s Twisted Pair connections

1.3 Power supply

1.3.1 Supply voltage LV

The following options for power supply are available:

- ▶ 6-pin terminal block

You will find information on connecting the supply voltage here:
[“Connecting the terminal blocks” on page 24](#)

1.3.2 Supply voltage HV

The following options for power supply are available:

- ▶ 6-pin terminal block

You will find information on connecting the supply voltage here:
[“Connecting the terminal blocks” on page 24](#)

1.4 Ethernet ports

You can connect terminal devices and other segments at the ports of the device via twisted pair cables.

You find information on the pin assignments for making patch cables here:
[“Pin assignments” on page 21](#)

1.4.1 10/100/1000 Mbit/s twisted pair port

This port is an RJ45 socket.

The 10/100/1000 Mbit/s twisted pair port allows you to connect network components according to the IEEE 802.3 10BASE-T/100BASE-TX/1000BASE-T standard.

This port supports:

- ▶ Autonegotiation
- ▶ Autopolarity
- ▶ Autocrossing
- ▶ 1000 Mbit/s full duplex
- ▶ 100 Mbit/s half-duplex mode, 100 Mbit/s full duplex mode
- ▶ 10 Mbit/s half-duplex mode, 10 Mbit/s full duplex mode

1.4.2 10/100 Mbit/s twisted pair port

This port is an RJ45 socket.

The 10/100 Mbit/s twisted pair port allows you to connect network components according to the IEEE 802.3 10BASE-T/100BASE-TX standard.

This port supports:

- ▶ Autonegotiation
- ▶ Autopolarity
- ▶ Autocrossing
- ▶ 100 Mbit/s half-duplex mode, 100 Mbit/s full duplex mode
- ▶ 10 Mbit/s half-duplex mode, 10 Mbit/s full duplex mode

1.4.3 Support of PoE

The device variants with PoE support Power over Ethernet (PoE) in accordance with IEEE 802.3af.

The PoE ports allow the connection and remote supply of, for example, IP telephones (Voice over IP), webcams, sensors, printer servers and WLAN access points. With PoE, power is supplied to these terminal devices through the twisted pair cable.

The Power over Ethernet function is activated both globally and on the PoE-capable ports on delivery. You will recognize the PoE-capable devices from the printed PoE logo.

The devices are supplied with PoE voltage via the internal voltage supply. The PoE voltage to the twisted-pair cables is supplied via the wire pairstransmitting the signal (phantom voltage).

The PoE voltage is uncoupled from the power supply. The individual ports are not electrically insulated from each other.

NOTICE

POTENTIAL EQUIPMENT DAMAGE

Ensure that the device does not exceed the specified maximum PoE power output.

Failure to follow these instructions can result in equipment damage.

For the maximum power available to PoE end devices in total, see the technical data: [See “Power consumption/power output” on page 35.](#)

1.4.4 10/100/1000 Mbit/s PoE port

This port is an RJ45 socket.

The 10/100/1000 Mbit/s twisted pair port allows you to connect network components according to the IEEE 802.3 10BASE-T/100BASE-TX/1000BASE-T standard.

This port supports:

- ▶ Autonegotiation
- ▶ Autopolarity
- ▶ Autocrossing
- ▶ 1000 Mbit/s full duplex
- ▶ 100 Mbit/s half-duplex mode, 100 Mbit/s full duplex mode
- ▶ 10 Mbit/s half-duplex mode, 10 Mbit/s full duplex mode
- ▶ Power over Ethernet (PoE)

1.4.5 10/100 Mbit/s PoE port


This port is an RJ45 socket.

The 10/100 Mbit/s twisted pair port allows you to connect network components according to the IEEE 802.3 10BASE-T/100BASE-TX standard.

This port supports:

- ▶ Autonegotiation
- ▶ Autopolarity
- ▶ Autocrossing
- ▶ 100 Mbit/s half-duplex mode, 100 Mbit/s full duplex mode
- ▶ 10 Mbit/s half-duplex mode, 10 Mbit/s full duplex mode
- ▶ Power over Ethernet (PoE)

1.5 Pin assignments

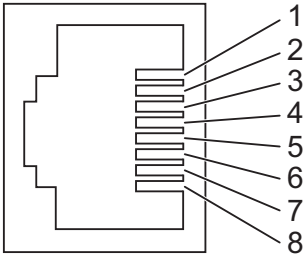RJ45	Pin	10/100 Mbit/s	1000 Mbit/s
	MDI mode		
	1	TX+	BI_DA+
	2	TX-	BI_DA-
	3	RX+	BI_DB+
	4	—	BI_DC+
	5	—	BI_DC-
	6	RX-	BI_DB-
	7	—	BI_DD+
	8	—	BI_DD-
	MDI-X mode		
	1	RX+	BI_DB+
	2	RX-	BI_DB-
	3	TX+	BI_DA+
	4	—	BI_DD+
	5	—	BI_DD-
	6	TX-	BI_DA-
7	—	BI_DC+	
8	—	BI_DC-	

1.6 Display elements

After the supply voltage is switched on, the device performs a self-test. During this process, various LEDs light up.

1.6.1 Device state

This LED provides information on the status of the power supply.

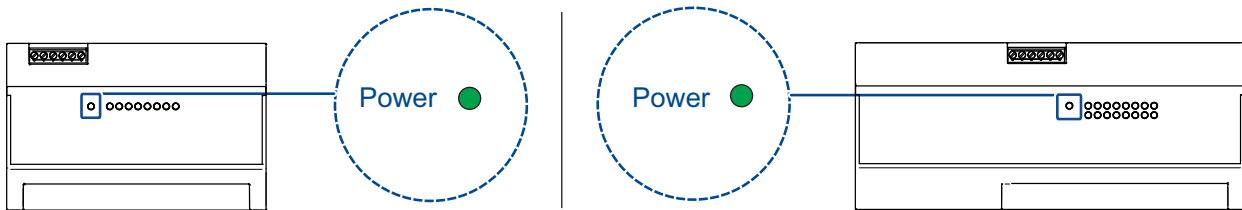


Figure 5: LED display elements for device status

Color	Activity	Meaning
green	lights up	Supply voltage is on Device is ready for operation
—	none	Supply voltage is too low Device is not ready for operation

1.6.2 Port status

These LEDs provide port-related information.

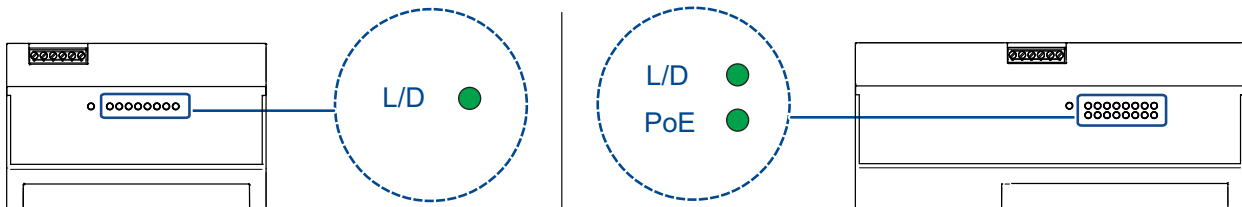


Figure 6: LED display elements for port status

L/D (link status/data)	Color	Activity	Meaning
	green	lights up	Device detects a valid link
	—	flashing	Device is transmitting and/or receiving data
	—	none	Device detects an invalid or missing link
PoE	Color	Activity	Meaning
	green	lights up	Powered device is supplied with power
	—	flashes 1 time a period	no power supply of the Powered Device as the power output required by the Powered Device cannot be provided on this port
	—	none	No powered device connected

2 Installation

On delivery, the device is ready for operation.

Perform the following steps to install the device:

- ▶ [Checking the package contents](#)
- ▶ [Installing and grounding the device](#)
- ▶ [Connecting the terminal blocks](#)
- ▶ [Connecting data cables](#)
- ▶ [Attach touch protection](#)
- ▶ [Operating the device](#)

2.1 Checking the package contents

- Check whether the package includes all items named in the section [“Scope of delivery” on page 36](#).
- Check the individual parts for transport damage.

2.2 Installing and grounding the device

You have the following options for mounting your device:

- ▶ [Installing the device onto the DIN rail](#)

2.2.1 Installing the device onto the DIN rail

Prerequisite:

The device is for mounting on a 35 mm DIN rail in accordance with DIN EN 60715.

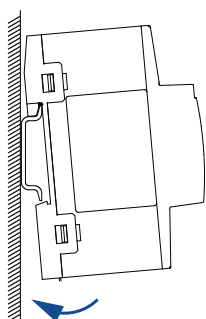


Figure 7: Mounting on the DIN rail

Perform the following work steps:

- Slide the upper snap-in guide of the device into the DIN rail.
- Push the device downwards and onto the DIN rail.
- Snap-in the device.

2.2.2 Grounding the device

Prerequisites:

- Use a wire diameter for the ground conductor that is no smaller than the diameter of the supply voltage connection, however of at least 0.5 mm² (AWG20).

The device is grounded via a 6-pin terminal block.

2.3 Connecting the terminal blocks



WARNING

ELECTRIC SHOCK

Exclusively connect a supply voltage that corresponds to the type plate of your device.

Never insert sharp objects (small screwdrivers, wires, etc.) into the connection terminals for the supply voltage, and do not touch the terminals.

Failure to follow this instruction can result in death, serious injury, or equipment damage.

The supply voltage is only connected with the ground connection via protective elements.

2.3.1 Supply voltage LV

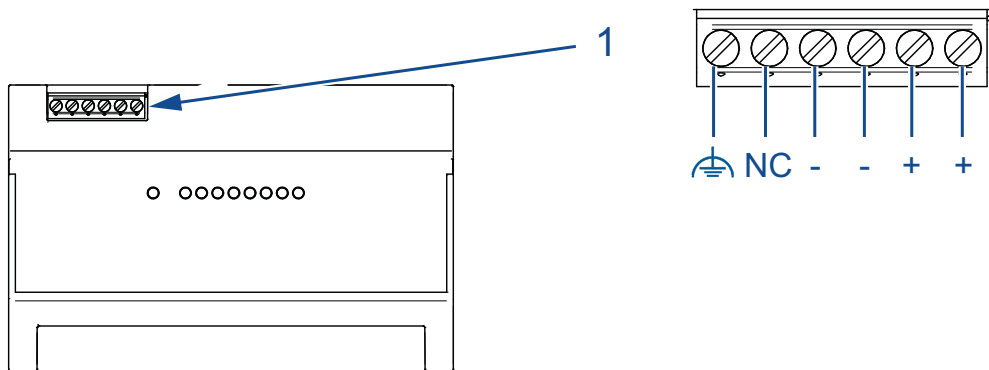


Figure 8: (1) Connection for DC voltage and AC voltage on the device

Type of the voltages that can be connected	Specification of the supply voltage
DC voltage	Rated voltage range DC: 12 V DC ... 48 V DC Voltage range DC incl. maximum tolerances: 9.6 V DC ... 60 V DC
AC voltage	Rated voltage range AC: 24 V AC, 50 Hz ... 60 Hz Voltage range AC incl. maximum tolerances: 18 V AC ... 30 V AC, 47 Hz ... 63 Hz

Table 1: Type and specification of the supply voltage

Perform the following work steps:

- Verify the required conditions for connecting the voltage supply.
See [“Requirements for connecting electrical wires” on page 9.](#)
- Connect the wires according to the pin assignment on the device with the clamps.
- Fasten the wires in the terminal block by tightening the terminal screws.

2.3.2 Supply voltage HV

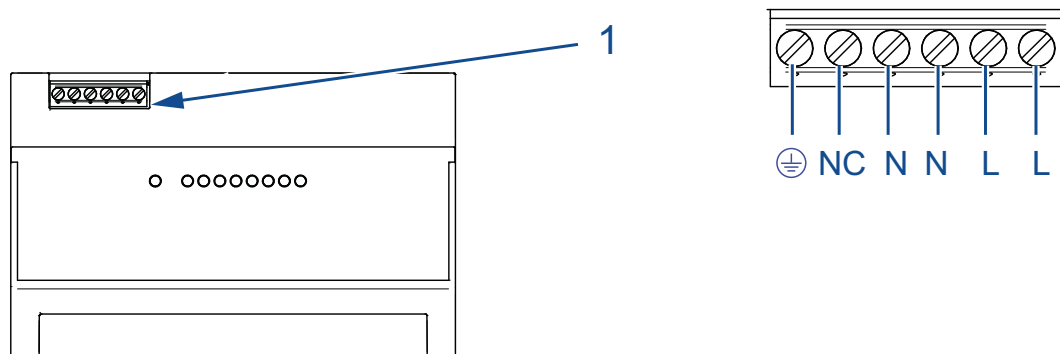


Figure 9: (1) AC voltage connection on the device

Type of the voltages that can be connected	Specification of the supply voltage
AC voltage	Rated voltage range AC: 100 V AC ... 240 V AC, 50 Hz ... 60 Hz Voltage range AC incl. maximum tolerances: 85 V AC ... 264 V AC, 47 Hz ... 63 Hz

Table 2: Type and specification of the supply voltage

Perform the following work steps:

- Verify the required conditions for connecting the voltage supply.
[See “Requirements for connecting electrical wires” on page 9.](#)
- Connect the wires according to the pin assignment on the device with the clamps.
- Fasten the wires in the terminal block by tightening the terminal screws.

2.4 Connecting data cables

Note the following general recommendations for data cable connections in environments with high electrical interference levels:

- Keep the length of the data cables as short as possible.
- Use optical data cables for the data transmission between the buildings.
- Ensure that the minimum distance of 10 mm (0.39 in) between datalines/ telecommunication lines and power lines is maintained.
- When using copper cables, provide a sufficient separation between the power supply cables and the data cables. Ideally, install the cables in separate cable channels.

- Verify that power supply cables and data cables do not run parallel over longer distances. To reduce inductive coupling, verify that the power supply cables and data cables cross at a 90° angle.
- Connect the data cables according to your requirements.
[See “Ethernet ports” on page 17.](#)

2.5 Attach touch protection

- Attach a suitable touch protection.

2.6 Operating the device

By connecting the supply voltage via the terminal block, you start the operation of the device.

3 Monitoring the ambient air temperature

Operate the device below the specified maximum ambient air temperature exclusively.

See [“General technical data” on page 31](#).

The ambient air temperature is the temperature of the air at a distance of 5 cm (2 in) from the device. It depends on the installation conditions of the device, for example the distance from other devices or other objects, and the output of neighboring devices.

4 Maintenance and service

When designing this device, Hirschmann largely avoided using high-wear parts. The parts subject to wear and tear are dimensioned to last longer than the lifetime of the product when it is operated normally. Operate this device according to the specifications.

Depending on the degree of pollution in the operating environment, check at regular intervals that the ventilation slots in the device are not obstructed.



CAUTION

RISK OF TRANSIENTS OR ELECTROSTATIC DISCHARGES

Do not open the housing.

Failure to follow these instructions can result in injury or equipment damage.

Note: You find information on settling complaints on the Internet at <http://www.beldensolutions.com/en/Service/Repairs/index.phtml>.

5 Disassembly

5.1 Removing the device

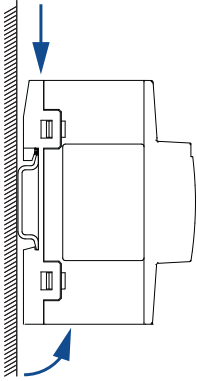


Figure 10: Removal from the DIN rail

Perform the following work steps:

- Disable the supply voltage.
- Remove the touch protection.
- Disconnect the power supply cables and signal lines.
- Disconnect the data cables.
- Disconnect the grounding.
- Press the device downwards and tilt the lower side towards you, then pull the device upwards away from the DIN rail.

6 Technical data

■ General technical data

Dimensions W × H × D	Building Automation Switch	See "Dimension drawings" on page 33.	
Module width	BAS20-8TX	8 modules	
	BAS20-8TX-HV	8 modules	
	BAS22-8TX-HV-55	12 modules	
	BAS22-8TX-HV-110	12 modules	
Weight	BAS20-8TX	250 g (8.82 oz)	
	BAS20-8TX-HV	250 g (8.82 oz)	
	BAS22-8TX-HV-55	410 g (14.46 oz)	
	BAS22-8TX-HV-110	410 g (14.46 oz)	
Supply voltage LV	▶ 1 voltage input		
	▶ Safety extra-low voltage		
	Rated voltage range	12 V DC ... 48 V DC 24 V AC, 50 Hz ... 60 Hz	
	Voltage range incl. maximum tolerances	9.6 V DC ... 60 V DC 18 V AC ... 30 V AC, 47 Hz ... 63 Hz	
	Connection type	6-pin terminal block with screw lock	
		Stripping length	6 mm (0.24 in)
		Tightening torque	4.4 lb-in ... 5.3 lb-in (0.5 Nm ... 0.6 Nm)
		min. conductor diameter	AWG26 (0.14 mm ²)
		max. conductor diameter	AWG16 (1.5 mm ²)
	Power loss buffer	10 ms at 20.4 V DC	
Back-up fuse	2 A ... 4 A, slow blow		
Peak inrush current	4 A		
Overvoltage category	Category II according to EN 60664-1		

Supply voltage HV	▶ 1 voltage input	
Rated voltage range	100 V AC ... 240 V AC, 50 Hz ... 60 Hz	
Voltage range incl. maximum tolerances	85 V AC ... 264 V AC, 47 Hz ... 63 Hz	
Connection type	6-pin terminal block with screw lock	
Stripping length	6 mm (0.24 in)	
Tightening torque	4.4 lb-in ... 5.3 lb-in (0.5 Nm ... 0.6 Nm)	
min. conductor diameter	AWG26 (0.14 mm ²)	
max. conductor diameter	AWG16 (1.5 mm ²)	
Power loss buffer	10 ms at 115 V AC 15 ms at 230 V AC	
Back-up fuse	16 A with 1.5 mm ² (AWG16) or smaller according to the wire diameter used	
Peak inrush current	30 A at 115 V AC 60 A at 230 V AC	
Overvoltage category up to 2000 m ASL (6562 ft ASL)	Category III according to EN 60664-1	
Overvoltage category above 2000 m ASL (6562 ft ASL)	Category II according to EN 60664-1	
Climatic conditions during operation	Ambient air temperature ^a	-5 °C ... +60 °C (+23 °F ... +140 °F) Derating
	Humidity	20 % ... 90 % (non-condensing)
	Air pressure	Without derating ▶ min. 795 hPa (+6562 ft; +2000 m) ▶ max. 1060 hPa (-400 m; -1312 ft) With derating -5 °C ... +50 °C (+23 °F ... +122 °F) ▶ min. 700 hPa (+3000 m; +9842 ft)
Climatic conditions during storage	Ambient air temperature ^a	-40 °C ... +85 °C (-40 °F ... +185 °F) up to 3 months -40 °C ... +70 °C (-40 °F ... +158 °F) up to 1 year -40 °C ... +50 °C (-40 °F ... +122 °F) up to 2 years 0 °C ... +30 °C (+32 °F ... +86 °F) up to 10 years
	Humidity	10 % ... 95 % (non-condensing)
	Air pressure	▶ min. 600 hPa (+4000 m; +13123 ft) ▶ max. 1060 hPa (-400 m; -1312 ft)
	Pollution degree	2 according to EN 60664-1
Protection classes	Degree of protection	IP20
Flammability classification		V-0 as per UL 94

a. Temperature of the ambient air at a distance of 5 cm (2 in) from the device

■ Dimension drawings

mm
inch

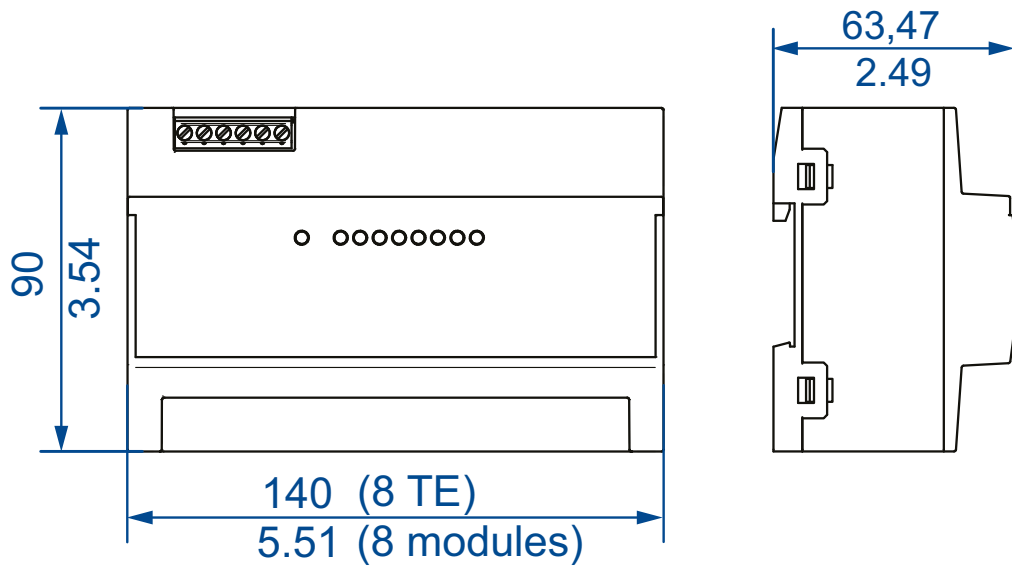


Figure 11: Device variants without PoE

mm
inch

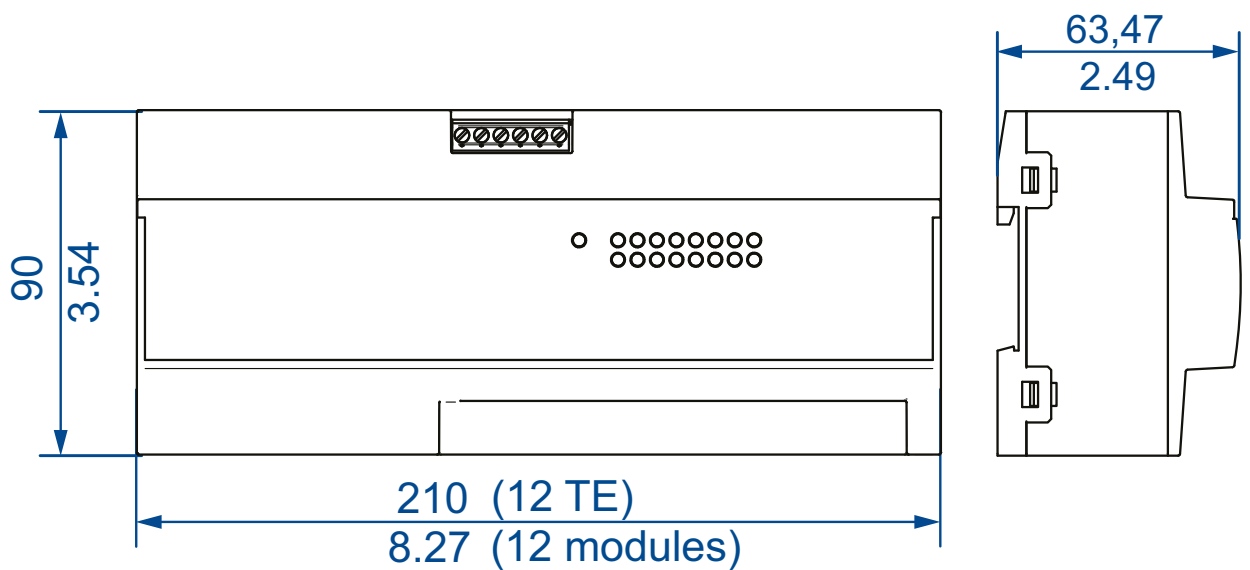


Figure 12: Device variants with PoE

■ EMC and immunity

EMC interference emission		
Radiated emission		
FCC 47 CFR Part 15		Class A
EN 55032		Class A
EN 61000-3-2		Class A
EN 61000-6-4		Fulfilled
Conducted emission		
FCC 47 CFR Part 15		Class A
EN 55032		Class A
EN 61000-3-2		Class A
EN 61000-6-4		Fulfilled
EMC interference immunity		
Electrostatic discharge		
EN 61000-4-2	Contact discharge	±4 kV
IEEE C37.90.3		
EN 61000-4-2	Air discharge	±8 kV
IEEE C37.90.3		
Electromagnetic field		
EN 61000-4-3	80 MHz ... 1000 MHz	max. 10 V/m
	1000 MHz ... 6000 MHz	max. 3 V/m
Fast transients (burst)		
EN 61000-4-4	DC supply connection	2 kV
EN 61000-4-4	Data line	2 kV (U/UTP) 4 kV (SF/UTP)
Voltage surges - DC supply connection		
EN 61000-4-5	line/ground	1 kV Supply voltage LV 2 kV Supply voltage HV
EN 61000-4-5	line/line	0.5 kV Supply voltage LV 1 kV Supply voltage HV
Voltage surges - data line		
EN 61000-4-5	line/ground	1 kV (U/UTP, SF/UTP)
Conducted disturbances		
EN 61000-4-6	150 kHz ... 80 MHz	10 V
Immunity		
IEC 60068-2-6, test Fc	Vibration	5 Hz ... 8.4 Hz with 3.5 mm amplitude 8.4 Hz ... 150 Hz with 1 g
IEC 60068-2-27, test Ea	Shock	15 g at 11 ms

■ Network range

10/100/1000 Mbit/s twisted pair port

Length of a twisted pair segment max. 100 m (328 ft) (for Cat5e cable)

Table 3: Network range: 10/100/1000 Mbit/s twisted pair port

■ Power consumption/power output

Device name	Max. power consumption	Power output
BAS20-8TX	1.4 W	4.8 Btu (IT)/h
BAS20-8TX-HV	1.4 W	4.8 Btu (IT)/h
BAS22-8TX-HV-55 without PoE load	2.5 W	8.6 Btu (IT)/h
BAS22-8TX-HV-55 with PoE load inc. 55 W	11 W + 55 W PoE	37.6 Btu (IT)/h + 55 W PoE
BAS22-8TX-HV-110 without PoE load	2.5 W	8.6 Btu (IT)/h
BAS22-8TX-HV-110 with PoE load inc. 110 W	16 W + 110 W PoE	54.6 Btu (IT)/h + 110 W PoE

Table 4: Power consumption/power output

■ Derating

Note the derating values for PoE device variants. The derating values depend on the ambient air temperature of the power supply unit combined with the PoE load and the input voltage.

Device name	Ambient temperature	Permitted PoE load
BAS22-8TX-HV-55	up to 45 °C (113 °F)	55 W
	45 °C ... 50 °C (113 °F ... 122 °F)	45 W
	50 °C ... 55 °C (122 °F ... 131 °F)	37 W
	55 °C ... 60 °C (131 °F ... 140 °F)	29 W
BAS22-8TX-HV-110	up to 40 °C (104 °F)	110 W
	40 °C ... 45 °C (104 °F ... 113 °F)	95 W
	45 °C ... 50 °C (113 °F ... 122 °F)	80 W
	50 °C ... 55 °C (122 °F ... 131 °F)	65 W
	55 °C ... 60 °C (131 °F ... 140 °F)	50 W

Table 5: Permitted PoE load in relation to ambient air temperature

Device name	Input voltage	Derating of PoE load
BAS22-8TX-HV-55	from 100 V AC	0 W
	100 V AC .. 90 V AC	5 W
	90 V AC ... 85 V AC	8 W

Table 6: Additional derating of PoE load in relation to input voltage

Device name	Input voltage	Derating of PoE load
BAS22-8TX-HV-110	from 120 V AC	0 W
	120 V AC ... 110 V AC	10 W
	110 V AC ... 100 V AC	17 W
	100 V AC .. 90 V AC	24 W
	90 V AC ... 85 V AC	27 W

Table 6: Additional derating of PoE load in relation to input voltage

■ Scope of delivery

Amount	Article
1 ×	Device
1 ×	Safety and general information sheet

■ Order number

Device	Order number
BAS20-8TX	942 307-001
BAS20-8TX-HV	942 307-002
BAS22-8TX-HV-55	942 307-003
BAS22-8TX-HV-110	942 307-004

■ Underlying technical standards

Name	
CSA C22.2 No. 142	Canadian National Standard(s) – Process Control Equipment – Industrial Products
EN 55032	Electromagnetic compatibility of multimedia equipment – Emission Requirements
EN 61000-6-2	Electromagnetic compatibility (EMC) – Part 6-2: Generic standards – Immunity for industrial environments
EN 61000-6-4	Electromagnetic compatibility (EMC) – Part 6-4: Generic standards – Emitted interference in industrial environments
EN 61000-3-2	Electromagnetic compatibility (EMC) – part 3-2: Threshold values – threshold values for harmonic currents (device input current ≤ 16 A per conductor)
EN 61000-3-3	Electromagnetic compatibility (EMC) – part 3-3: Threshold values – limitation of voltage changes, voltage fluctuations and flickering in public low power supply networks for devices with a rated current ≤ 16 A per conductor that are not subject to any special connection condition
EN 61131-2	Programmable controllers – Part 2: Equipment requirements and tests
FCC 47 CFR Part 15	Code of Federal Regulations
UL 61010-1	Safety requirements for electrical equipment for measurement, control, and laboratory use - Part 1: General requirements
UL 61010-2-201	Safety requirements for electrical equipment for measurement, control, and laboratory use - Part 2-201: Particular requirements for control equipment

Table 7: List of the technical standards

The device has an approval based on a specific standard exclusively if the approval indicator appears on the device casing.

The device generally fulfills the technical standards named in their current versions.

A Further support

Technical questions

For technical questions, please contact any Hirschmann dealer in your area or Hirschmann directly.

You find the addresses of our partners on the Internet at <http://www.hirschmann.com>.

A list of local telephone numbers and email addresses for technical support directly from Hirschmann is available at <https://hirschmann-support.belden.com>.

This site also includes a free of charge knowledge base and a software download section.

Customer Innovation Center

The Customer Innovation Center is ahead of its competitors on three counts with its complete range of innovative services:

- ▶ Consulting incorporates comprehensive technical advice, from system evaluation through network planning to project planning.
- ▶ Training offers you an introduction to the basics, product briefing and user training with certification.
You find the training courses on technology and products currently available at <https://www.belden.com/solutions/customer-innovation-center>.
- ▶ Support ranges from the first installation through the standby service to maintenance concepts.

With the Customer Innovation Center, you decide against making any compromises in any case. Our client-customized package leaves you free to choose the service components you want to use.

Internet:

<https://www.belden.com/solutions/customer-innovation-center>



HIRSCHMANN

A **BELDEN** BRAND